Fermilab

SURVEY ID	4277

NOISE SAMPLING FIELD NOTES FORM

DATE	SAMPLE #(s)	SAMPLED BY (print and sign)	LOCATION
1-23-12	120123AP01 - 120123AP13	A. Pavnica Amy Pavnica	GCC CRC

INSTRUMENT USED	Quest SLM	TYPE OF SAMPLE (Personal or Area)	Area

PERSONNEL: Name, ID#, Division or Section, Job Title OTHERS: Describe location Of Sample (Diagram Or Photo If Possible)
X

DESCRIBE ACTIVITES, CONDITIONS, NOISE SOURCE (S)
Computers, cooling units

SLM RESULTS

TIME ON	TIME OFF	TOTAL TIME
15:15	15:30	15 min

Sample #	LOCATION	dBA	Sample #	LOCATION	dBA
	See map				

OCTAVE BAND ANALYSIS RESULTS

TIME ON	TIME OFF	TOTAL TIME

FREQ. HZ	dB	FREQ. HZ	dB	FREQ. HZ	dB		dBA RESULTS
31.5		250		2000			
63		500		4000			
125		1000		8000			

DOSIMETER RESULTS

Fermilab

SURVEY ID	4277

NOISE SAMPLING FIELD NOTES FORM

TIME ON	TIME OFF	TOTAL TIME

HTL L-AVG		LTL L-AVG		3dB LEQ		3dB DOSE	
PEAK LEVEL		HTL DOSE		LTL DOSE		3dB SEL	
SLOW MAX		HTL TWA		LTL TWA			
OL TIME		PAUSE TIME		RUN TIME			

PPE OR OTHER CONTROLS

although the computer room is generally not occupied for a full 8 hrs, the use of hearing protection is recommended while working in these rooms, and required for 8 hours or more.

COMMENTS

RECOMMENDATIONS

REPRESENTATIVE SAMPLING FOR: List Name(s) and ID#(s)

REPORT COPIES TO:

INSTRUMENTATION

Fermilab

SURVEY ID	4277

NOISE SAMPLING FIELD NOTES FORM

EQUIPMENT	MANUFACTURER	MODEL NUMBER
SLM	Quest	215

SERIAL NUMBER	MANUFACTURER CAL DUE	
M0030010	Dec. 17, 2010	

PRE FIELD CAL BY (SIGN)	DATE OF FIELD CAL (PRE)	POST FIELD CAL BY (SIGN)	DATE OF FIELD CAL POST	
A. Pavnica	1-23-12	A. Pavnica	1-23-12	

CAL DEVISE USED & MODEL #	CAL DEVISE SERIAL NUMBER	CAL DEVISE CAL DUE DATE
Quest Sound Calibrator CA-12	V0030030	5-31-12

FIELD CAL RESULTS (PRE)	FIELD CAL RESULTS (POST)	
110 dBA	110 dBA	

CALCULATIONS

EFFECTIVENESS OF HEARING PROTECTION

OTHER
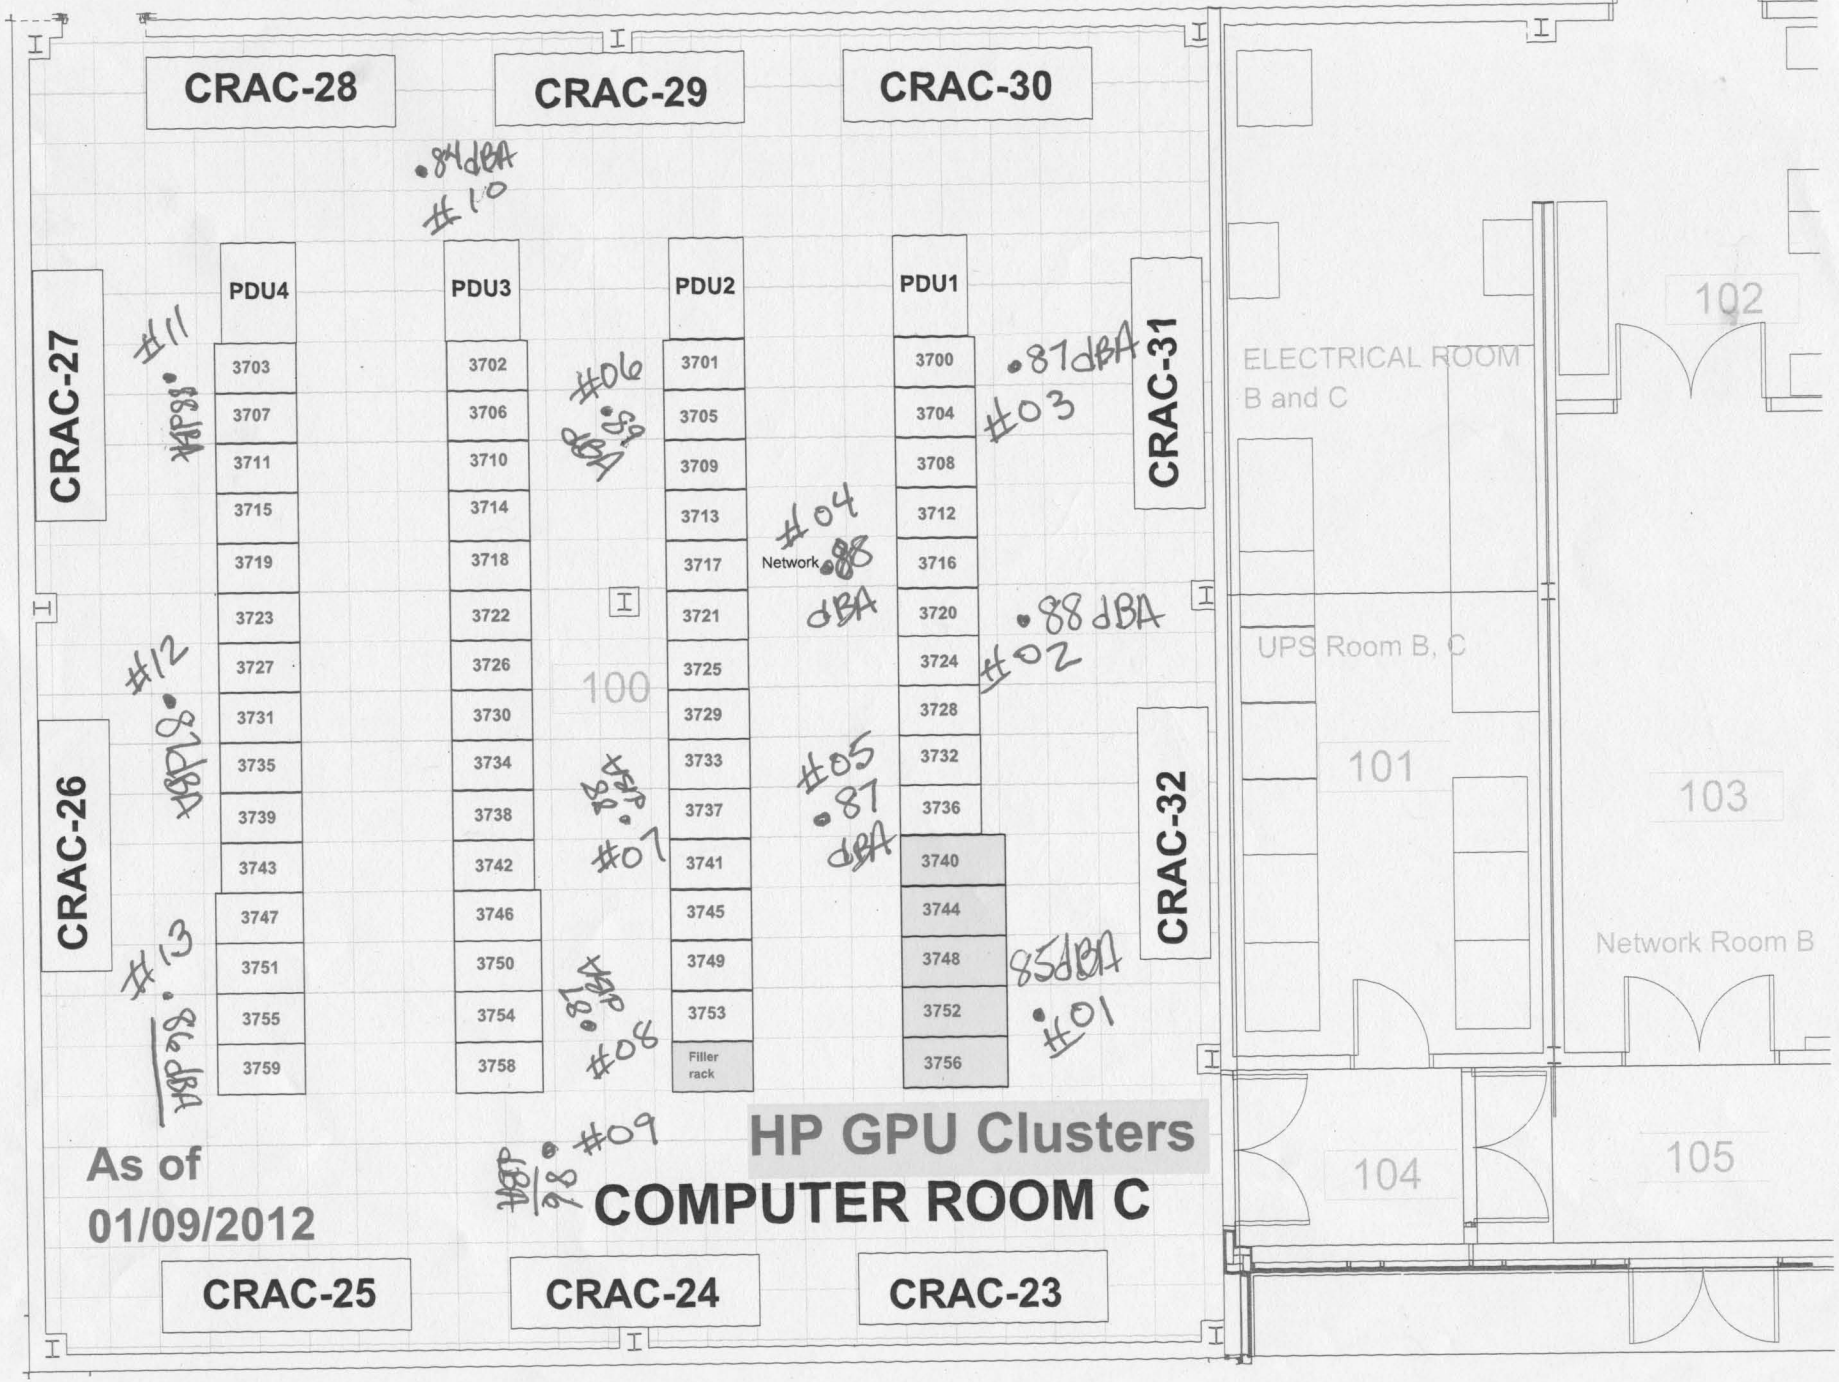
1-23-12 3:15 - 3:30 pm Survey ID #4277