


All Experimenters Meeting


Adam Walters
Computing Division
January 7, 2008



Near Miss Water Leak

- 3rd floor of Feynman Computing Center
- Early AM on Monday, 01/07/08
- Water supply to a humidification system
- Leak started on FCC3 and flowed to FCC1
- Water leak was adjacent to computer rooms did not trigger water detection system in computer rooms

Utility Closet on FCC3

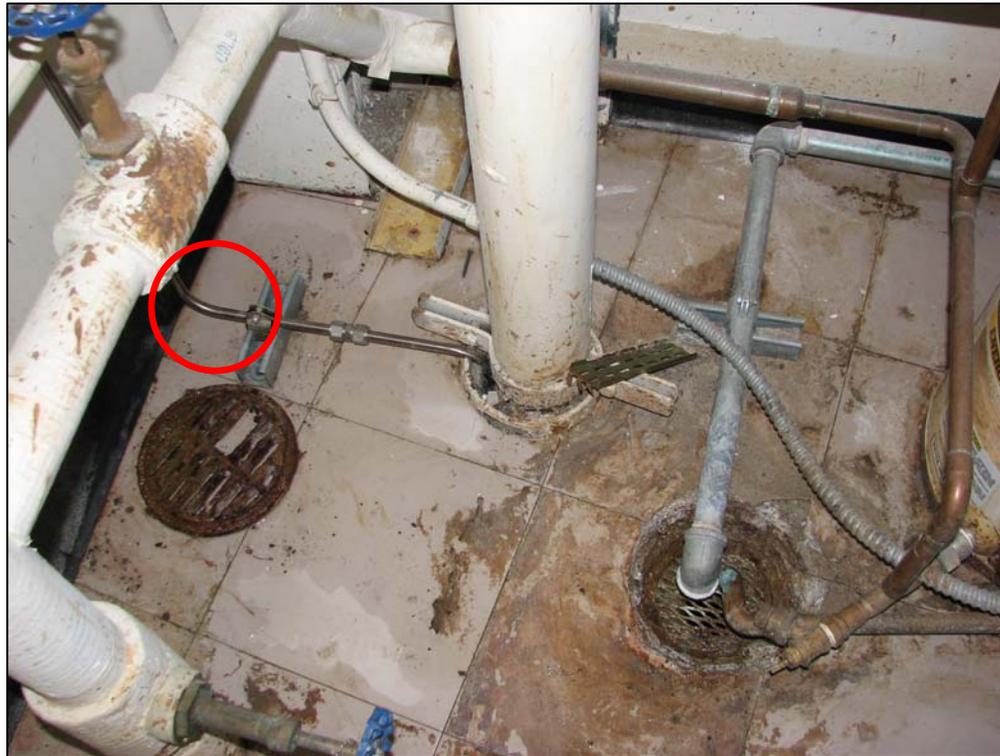

Leak developed at the bend of steel pipe

Damage on FCC2



- Corner next to electrical closet

Damage on FCC2



- SL8500 Tape Library 4FT to the right

Water on FCC1 – ground floor

- The source of the water in the photo is the other side of the door in the electrical room.





Near Miss Water Leak

- No damage to computing
 - Email, Networking, Scientific Computing
- No damage to electrical or networking
- Minor damage to walls
- A happy ending this time...